


State	Proj. No.	Sheet No.
MO		

Picn dimensions are based on installation at 60°F. The expansion gap and other dimensions shall be increased or decreased for each 10° rise or fall in temperature of installation.


Cured pile anchors shall be drilled and concrete expansion or cast-in-place wing type threaded inserts, the minimum ultimate pull-out capacity for these anchors shall be 2700 lbs. in $\pm 0 = +400$ lbs. in overdrive. Load anchors will not be permitted in the barrier for anchors drilled not be drilled until the concrete is at least 7 days old.

Payment for furnishing, coating or galvanizing and installing the structural steel for the expansion joint will be considered completely covered by the contract unit price for Strip Seal Expansion Joint System.


PART SECTION B-E

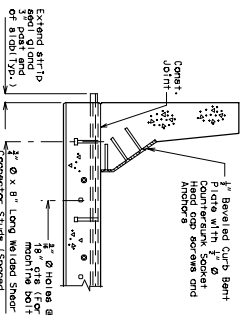


PART SECTION C-C



PART ELEVATION AT END OF
BEVELED CURB BENT PLATE



DETAIL OF JOINT ARMOR



DETAILS OF STRIP SEAL AT END BENT NO.

Note: This drawing is not to scale. Follow dimensions.

Shoot No. of

COUNTY STS07

Detailed
Checked